

BXUV.P527 Fire Resistance Ratings - ANSI/UL 263

[Page Bottom](#)

[Notice of Disclaimer](#)

Previous Page

Fire Resistance Ratings - ANSI/UL 263


[Guide Information](#)


Design No. P527

December 06, 2000

Restrained Assembly Rating-1 and 1-1/2 Hr (See Items 4, 4A and 4B)

Unrestrained Assembly Rating-1 and 1-1/2 Hr (See Items 4, 4A and 4B)

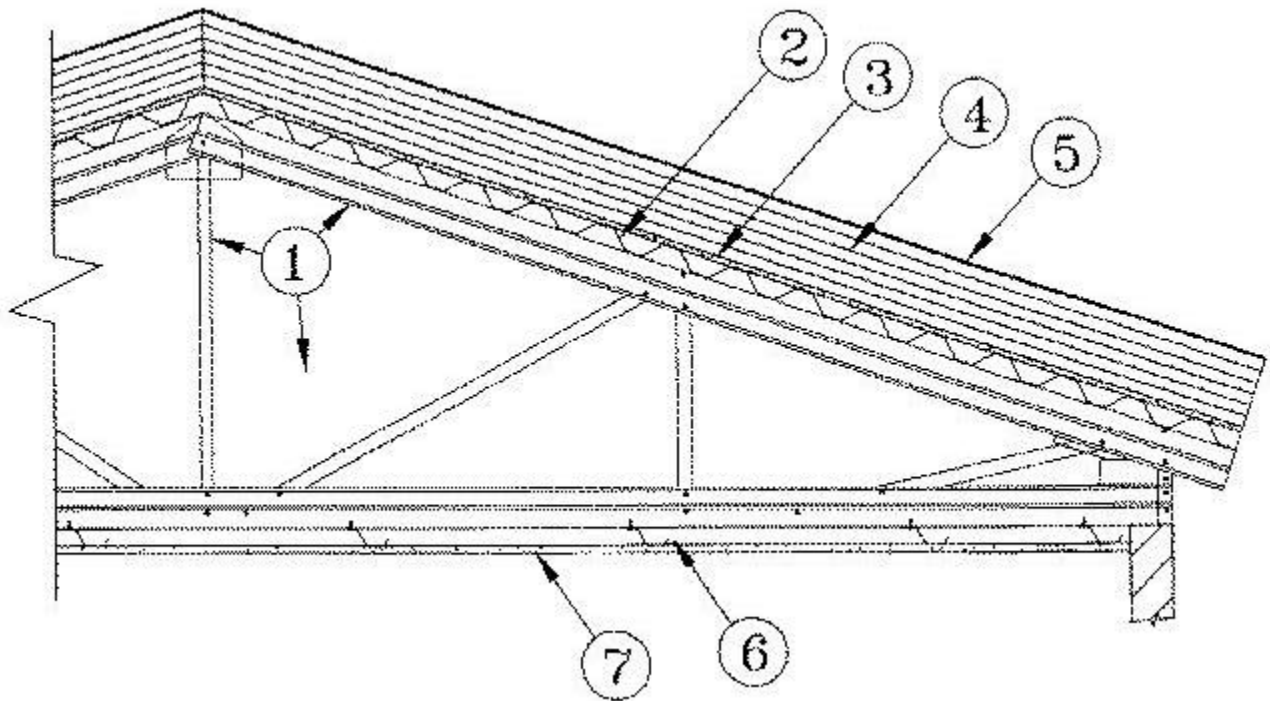

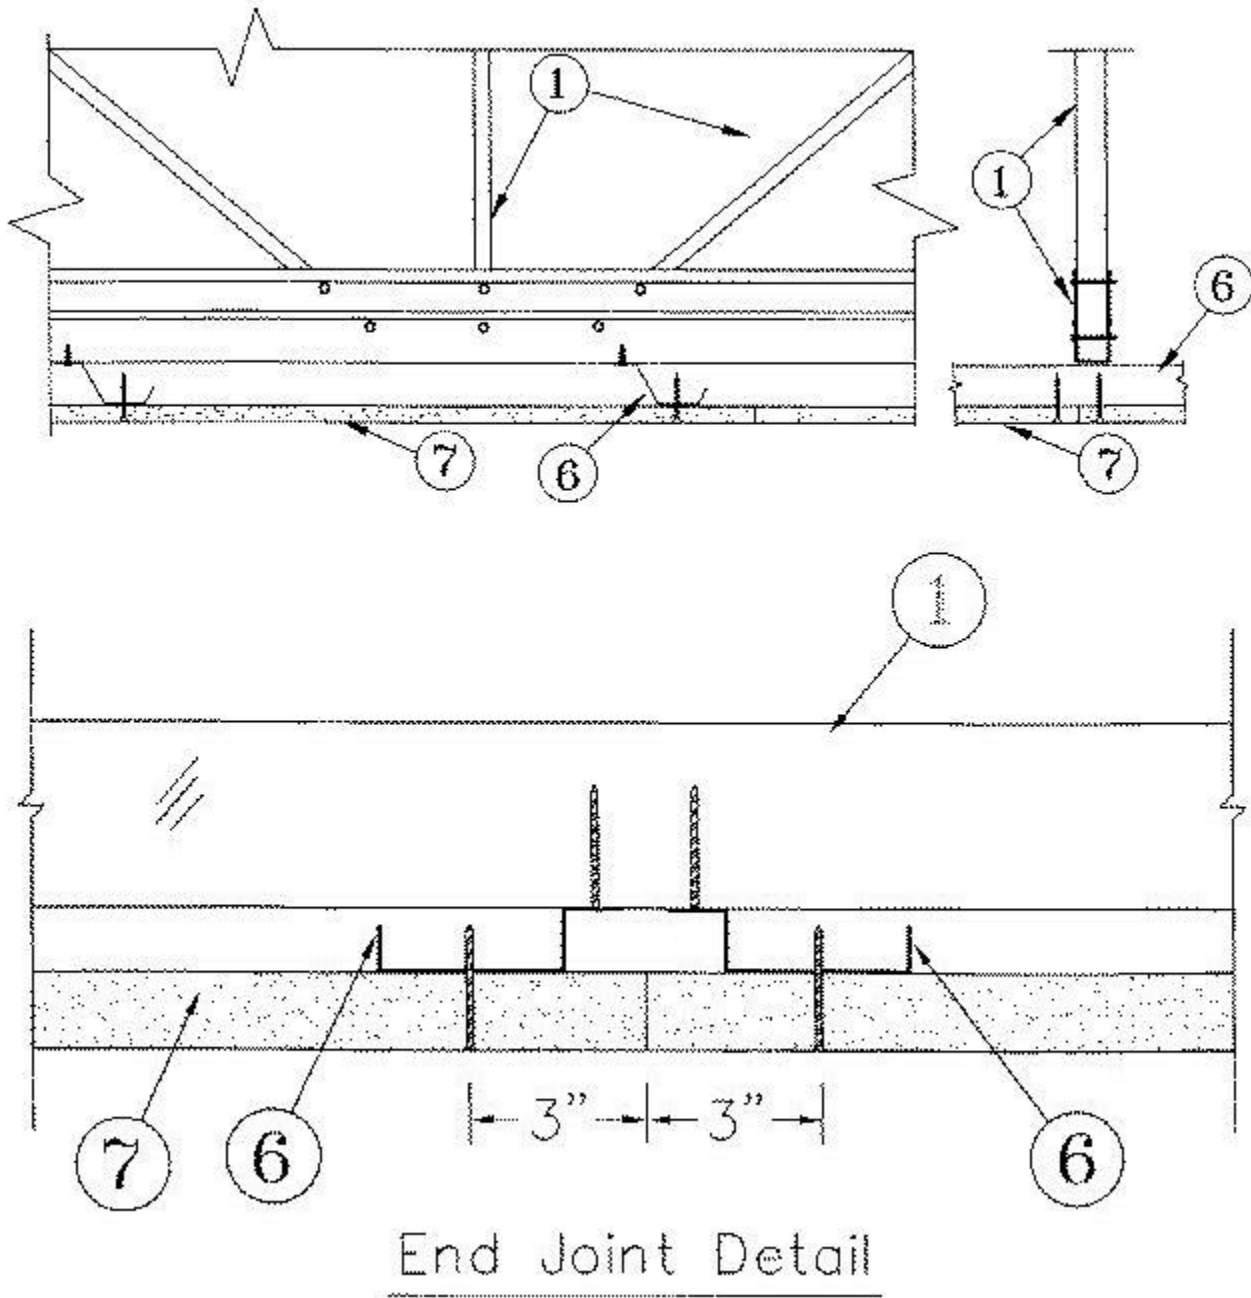

1. **Structural Steel Members*** Pre-fabricated light gauge steel truss system consisting of cold-formed, galvanized steel chord and web sections. Trusses fabricated in various sizes, depths, and from various steel thickness. Trusses spaced a max of 48 in. OC.

ALLIED STUDCO — Amkey System, Pre-fabricated Light Gauge Steel Truss System.

2. **Steel Roof Deck** (Classified or Unclassified)-Corrugated or fluted steel form units, min 22 MSG painted or galv steel, welded or mechanically fastened max 12 in. OC to truss-top chords.

3. **Cementitious Backer Units*** Nom 1/2 or 5/8 in. thick sheets. End-joints to occur over crests of steel roof deck with end-joints staggered in adjacent rows. Units loosely laid, adhered or mechanically attached to steel roof deck.

UNITED STATES GYPSUM CO — Durock Exterior Cement Board or Durock Cement Board.

3A. **Gypsum Board** (Classified or Unclassified)—(Not Shown) — As an alternate to Item 3, gypsum sheathing, min 1/2 in. thick, applied perpendicular to steel roof deck. End joints to occur over crests of steel roof deck. Sheathing loosely laid, adhered or mechanically attached to steel roof deck. See Gypsum Board (CKNX) category for names of Classified companies.

4. **Roof Insulation —Foamed Plastic*** Any polyisocyanurate foamed plastic insulation boards bearing the UL Classification Marking. No min thickness required for the 1 hr assembly rating and 2 in. for the 1-1/2 hr assembly rating, with no limit on max overall thickness. Boards installed over the cementitious backer units (Item 4) or gypsum sheathing (Item 4A), with the end-joints staggered in adjacent rows. When applied in more than one layer, each layer of board to be offset in both directions from layer below in order to lap all joints. Boards loosely laid, adhered or mechanically fastened to cementitious backer units or gypsum sheathing, and to steel roof deck (Item 3). See Foamed Plastic (CCVW) Category in the Fire Resistance Directory.

4A. **Roof Insulation —Foamed Plastic*** (Not Shown) — As an alternate to Item 4 — For 1 and 1-1/2 hr ratings only. Any polystyrene foamed plastic insulation boards bearing the UL Classification Marking. No min thickness required for the 1 hr assembly ratings and 2 in. for the 1-1/2 hr assembly ratings, with no limit on max overall thickness. Boards installed over the cementitious backer units (Item 3) or gypsum sheathing (Item 3A), with the end-joints staggered in adjacent rows. When applied in more than one layer, each layer of board to be offset in both directions from layer below in order to lap all joints. Boards loosely laid, adhered or mechanically fastened to cementitious backer units or gypsum sheathing, and to steel roof deck (Item 2). See Foamed Plastic (BRYX) category in the Building Materials Directory or Foamed Plastic (CCVW) category in the Fire Resistance Directory.

4B. **Roof Insulation —Mineral and Fiber Boards*** (Not Shown) — As an alternate to Item 4— Mineral wool, glass fiber or perlite insulation boards, 24 by 48 in. min size, applied in one or more layers. No min thickness required for the 1 hr assembly rating and 2 in. for the 1-1/2 hr assembly rating with no limit on max overall thickness. Boards installed over the cementitious backer units (Item 3) or gypsum sheathing (Item 3A), with the end-joints staggered in adjacent rows. When applied in more than one layer, each layer of board to be offset in both directions from layer below in order to lap all joints. Boards loosely laid, adhered or mechanically fastened to cementitious backer units or gypsum sheathing, and to steel roof deck (Item 2). See Mineral and Fiber Boards (BQXR) Category in the

Building Materials Directory or Mineral and Fiber Boards (CERZ) Category in the Fire Resistance Directory.

5. Roof Covering* Consisting of hot-mopped or cold-application materials compatible with insulation(s) described herein which provide Class A, B or C coverings. See Roofing Materials and Systems Directory-Roof Covering Materials (TEVT).

5A. Roofing Membrane* In lieu of Item 5, single-ply membrane that is either ballasted, adhered or mechanically attached to the insulation(s) described herein as permitted under the respective company's Classification. See Fire Resistance Directory-Roofing Membranes (CHCI) Category.

5B. Metal Roof Deck Panels* In lieu of or in addition to Items 5 and 5A, the roof covering may consist of mechanically fastened galv or painted steel roof deck panels. Panels may be installed above a steel purlin assembly per metal roof deck manufacturer's specifications. Steel purlin assembly to be installed transverse to steel roof trusses (Item 1). A line of sealant or tape may be used at panel side and end laps. See Metal Roof Deck Panels Category in the Roofing Materials and Systems Directory (TJPV) or Fire Resistance Directory (CETW) for names of manufacturers.

6. Resilient Channels Formed of 25 MSG galv steel, installed perpendicular to the trusses (Item 1), spaced a max of 16 in. OC. Channels oriented opposite at wallboard butt-joints. Channel splices overlapped 4 in. beneath steel trusses. Channels secured to each truss with Type S12 by 1/2 in. long screws.

7. Gypsum Board* One layer of nom 5/8 in. thick by 48 in. wide boards, installed with long dimension parallel to trusses. Attached to the resilient channels using 1 in. long Type S bugle-head screws spaced 12 in. OC along butted end-joints and 12 in. OC in the field.

CANADIAN GYPSUM COMPANY — Types C, IP-X2, IPC-AR.

UNITED STATES GYPSUM CO — Types C, IP-X2, IPC-AR.

YESO PANAMERICANO S A DE C V — Types C, IP-X2, IPC-AR.

8. Finishing System (Not Shown) — Vinyl, dry or premixed joint compound, applied in two coats to joints and screw heads; paper tape, 2 in. wide, embedded in first layer of compound over all joints.

9. Bridging (Not Shown) — Location of lateral bracing for truss chord and web sections to be specified on truss engineering.

Alternate Ceiling Membrane — Not Shown

10. Steel Framing Members

a. **Main Runners** Installed perpendicular to Structural Steel Members, - Nom 12 ft long, 15/16 in. or 1-1/2 in. wide face, spaced 4 ft OC. Main runners hung a min of 2 in. from bottom chord of Structural Steel Members with 12 SWG galv steel wire. Wires located a max of 48 in. OC.

b. **Cross tees or channels** Nom 4 ft long, 15/16 in. or 1-1/2 in. wide face, or cross channels, nom 4 ft long, 1-1/2 in. wide face, installed perpendicular to the main runners, spaced 16 in. OC. Additional cross tees or channels used at 8 in. from each side of butted wallboard end joints. The cross tees or channels may be riveted or screw-attached to the wall angle or channel to facilitate the ceiling installation.

c. **Wall angles or channels** Used to support steel framing member ends and for screw-attachment of the gypsum wallboard - Painted or galvanized steel angles with 1 in. legs, or channels with 1 in. legs and 1-9/16 in. deep, attached to walls at perimeter of ceiling with fasteners 16 in. OC.

CGC INTERIORS, DIV OF

CGC INC — Type DGL or RX

USG INTERIORS INC — Type DGL or RX

11. Gypsum Board* For use with Steel Framing Members (Item 10) - One layer of nominal 5/8 in. thick by 48 in. wide boards, installed with long dimension parallel to the main runners. Wallboard fastened to each cross tee or channel with five wallboard screws, with one screw located at the midspan of the cross tee or channel, one screw located 12 in. from and on each side of the cross tee or channel mid span, and one screw located 1-1/2 in. from each wallboard side joint. Except at wallboard end joints, wallboard screws shall be located on alternating sides of cross tee flange. At wallboard end joints, wallboard screws shall be located 1/2 in. from the joint. Wallboard fastened to main runners with wallboard screws 1/2 in. from side joints, midway between intersections with cross tees or channels (16 in. OC). End joints of adjacent wallboard sheets shall be staggered not less than 32 in. Wallboard sheets screw attached to leg of wall angle with wallboard screws spaced 12 in. OC. Joints treated as described in Item 8.

CANADIAN GYPSUM COMPANY — Type C, IP-X2, IPC-AR

UNITED STATES GYPSUM CO — Type C, IP-X2, IPC-AR

YESO PANAMERICANO S A DE C V — Type C, IP-X2, IPC-AR

*Bearing the UL Classification Mark

[Page Top](#)

[Notice of Disclaimer](#)

Previous Page

[UL Listed and Classified Products](#) [UL Recognized Components](#) [Products Certified for Canada](#)

This page and all contents are Copyright © 2001 by Underwriters Laboratories Inc.®

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Listed and covered under UL's Follow-Up Service. Always look for the Mark on the product.